
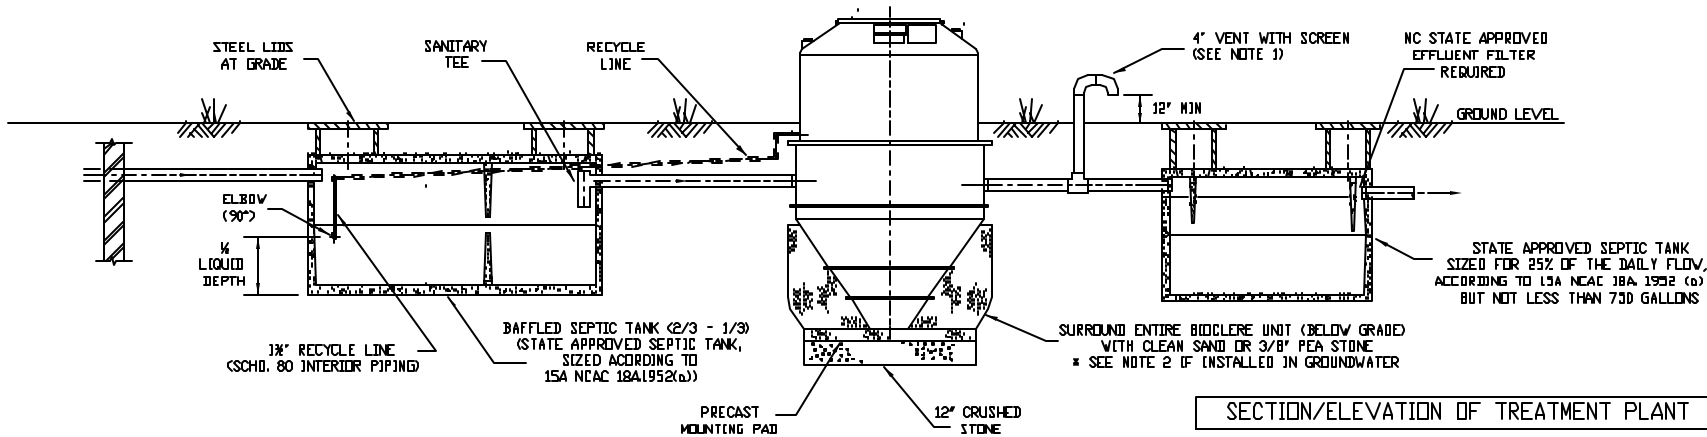
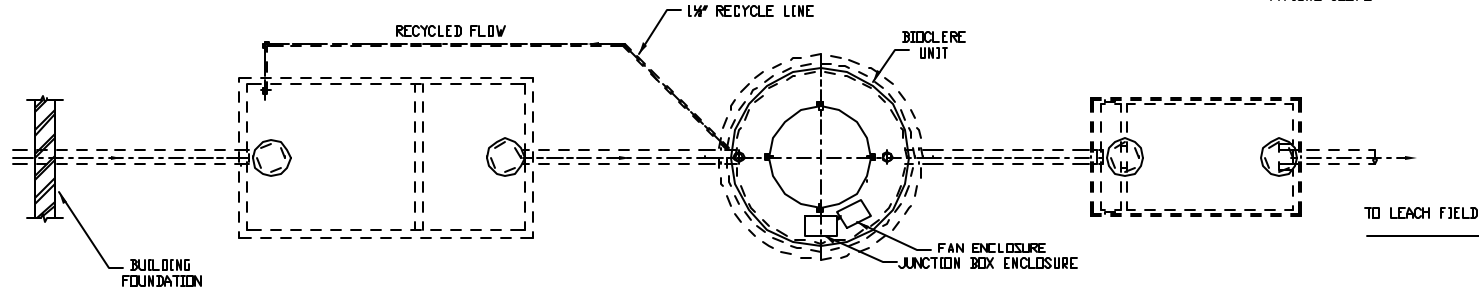


NOTES: UNLESS OTHERWISE SPECIFIED:


1. VENT MAY BE RUN UP TO THE ROOF OF THE BUILDING.
2. IF INSTALLED IN GROUND WATER CONTACT SITE ENGINEER FOR ANCHORING REQUIREMENTS.
3. CONTRACTOR IS TO SUPPLY ALL CONCRETE STRUCTURES AND PERFORM INSTALLATION.
4. OSHA RAILS AND LADDER REQUIRED IF TOP OF BIOCLERE IS GREATER THAN 48" ABOVE GRADE.
5. MINIMUM 4" DIA. SCHD. 40 PIPE BEFORE AND AFTER BIOCLERE AT 2% SLOPE.

N.C. GENERAL FLOW SCHEMATIC

PLAN ON TREATMENT PLANT



SECTION/ELEVATION OF TREATMENT PLANT



**DISTRIBUTION STATEMENT**  
THE DESIGN AND DETAIL OF THIS DRAWING IS THE PROPERTY OF AWT ENVIRONMENTAL, AND IS NOT TO BE USED EXCEPT IN CONNECTION WITH OUR WORK. DESIGN AND INVENTION RIGHTS ARE RESERVED. NO FURTHER DUPLICATION AND DISTRIBUTION OF THIS DOCUMENT IS PERMITTED WITHOUT PRIOR WRITTEN PERMISSION.



241 DUCHAINE BLVD.  
P.O. BOX 50120  
NEW BEDFORD, MA 02745  
(508) 998-7577 FAX (508) 998-7177

TITLE	TYPICAL FLOW SCHEMATIC
DRAWING NO.	UK.1266-8
REVISION	A
DATE	13 FEB 02
DWN BY	P.WILLEY
SCALE	1 : 60
SHEET #	B / A3
	1 of 1